EnOcean Interface for Mitsubishi air conditioners

STC-Mitsubishi A/C

EnOcean Interface for Mitsubishi air conditioners. Compatible with all models of Domestic and Mr. Slim lines of air conditioners commercialised in Europe.

User's Manual

thermokon

Sensortechnik GmbH

Issue Date: 02/05/2011

Directory

3 4
4
6
6
7
7
8
8
8
9
10
12
13
14
14
14
15
16
16
17
17
17
18
19
24
25
28
29
30

1. Presentation



STC-MITSUBISHI A/C devices allow a complete and natural integration of Mitsubishi Electric air conditioners with EnOcean control systems both in their 868 MHz and 315 MHz versions.

Compatible with all models of Domestic and Mr. Slim lines of air conditioners commercialised in Europe. Other models from different lines are compatible too (check Table 8.1).

1.1. Main Features:

- Reduced dimensions.
- Quick installation.
- External power not required.
- Direct connection to the Mitsubishi Electric AC indoor unit.
- Fully EnOcean interoperable.
- Multiple profiles
- Control of the AC unit based in the ambient temperature read by the own AC unit, or in the ambient temperature read by any EnOcean thermostat.
- Total Control and Monitoring of the AC unit from EnOcean, including monitoring of AC unit's state of internal variables, and error indication and error code.
- AC unit can be controlled simultaneously by the IR remote control of the AC unit and by EnOcean devices.
- Implements the newly approved HVAC EEP's
- Advanced room control functionalities.

1.2. Typical Application

In Figure 1.1 it is shown a typical application of STC-MITSUBISHI A/C in a hotel room. The different devices that control the A.C unit, like switches, Key cards, window contacts, are connected to it through the STC-MITSUBISHI A/C.

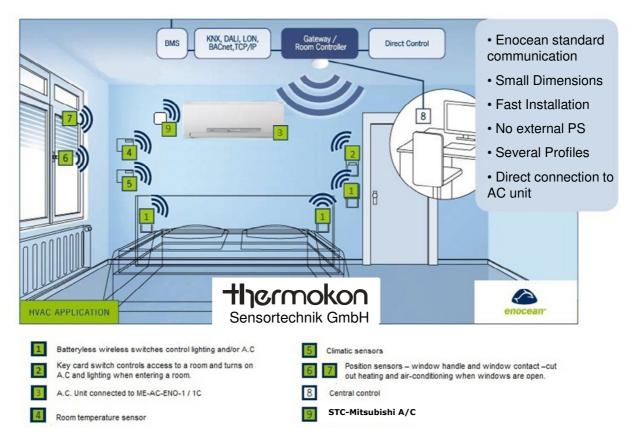


Figure 1.1 Typical application of STC-MITSUBISHI A/C in a hotel

A schematic view of what it could be the application shown in Figure 1.1 can be seen in Figure 1.2. The connection diagram of the A.C with the STC-MITSUBISHI A/C and some of the supported EnOcean devices are shown

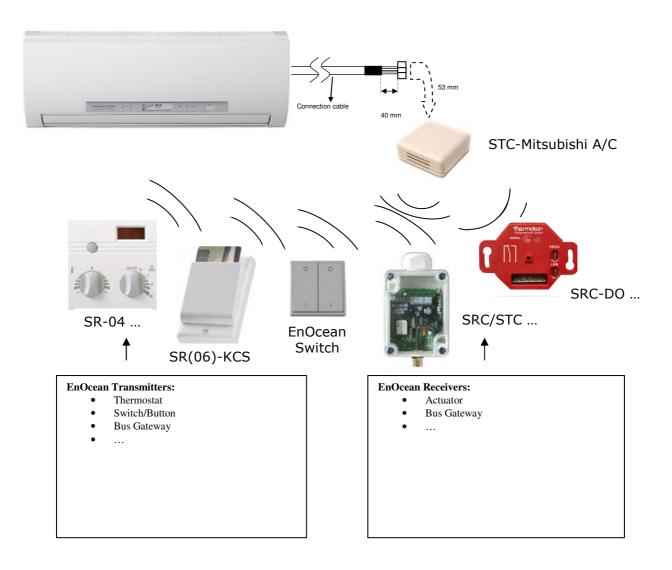


Figure 1.2 Example of STC-MITSUBISHI A/C control or actuation devices

2. Connection and placement

2.1. Connection

Disconnect mains power from the AC unit. Open the front cover of the indoor unit in order to have access to the internal control board. In the control board locate the socket connector marked as:

CN92	in Mr.Slim models.
or	
CN105	in any other models.

Using the cable that comes with the interface, insert one of its connectors, the one installed in the shortest uncovered part, into the socket of the STC-MITSUBISHI A/C , and the other connector, the one installed in the largest uncovered part, to the socket **CN92** or **CN105** of the AC unit's electronic circuit. Close the AC indoor unit's front cover again.

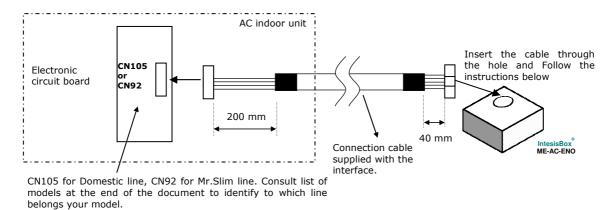


Figure 2.1 Device connection diagram

Important: Extending or shortening the length of connection cable included with the interface may cause it to malfunction.

To connect the device to the AC, the recommended methods are the ones in Figure 2.2

- Method1: The lead hole is place above CON1 (Figure 2.2 or Figure 3.1)
- Method2: The lead hole is placed on the opposite side. Use the supplied staple to fix the cable to the screw used for wall fixing.

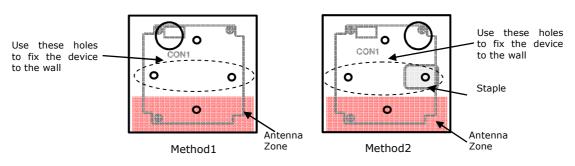


Figure 2.2 Connection methods

Important: The cable should not be placed on top or the antenna zone (area marked in Figure 2.2) as the performance of the device might be affected. For this same reason never use a metallic screw in the subjection hole on top of this antenna zone.

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 6 of 31

2.2. Placement

The STC-MITSUBISHI A/C interface antenna has a better sensibility when the device is placed vertically, and therefore this is the preferred position when placed (antenna zone should be located in the bottom side, floor side, once the device is fixed to the wall).

The coverage distance (see Table 2.1) of the signal emitted by the STC-MITSUBISHI A/C , or by any other EnOcean device, is determined by the room geometry and where they are placed. As an example, long narrow corridors with wide walls are an adverse situation. People or other obstacles can reduce the coverage distance too. Is therefore advice to always think in the worst possible scenario to decide the placement of the device to ensure a good stability in the radio system.

Coverage distance	Conditions
< 30 m	Under ideal conditions: Broad room, no obstacles and good antenna positions.
< 20 m	The room is filled with furniture and people And penetration through up to 5 dry walls or up to 2 brick walls or up to 2 aero concrete walls
< 10 m	Identical to the previous case but the receiver is placed to a room corner or range along a narrow floor.
< 1 m	Metal-reinforced ceilings at upright penetration angle (in strong dependence of reinforcement density and antenna positions).

Table 2.1 Device coverage distance

2.2.1 Screening zones

It is important not to place the device in a place where the airwaves must go through a metallic object as they create a screening zone where the receivers are not going to be able to receive the EnOcean telegrams. This situation is shown in Figure 2.3a.

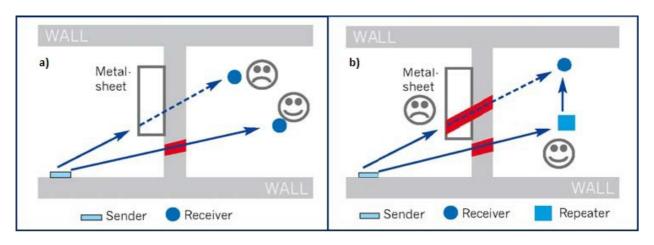


Figure 2.3 a) Screening zone b) solution with a repeater

The situation of one of the receivers doesn't allow it to receive the transceiver telegrams. To solve this situation the use or a repeater outside the screening zone (Figure 2.3b) is recommended. The telegrams will be retransmitted from there to the receiver

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 7 of 31

2.2.2 Penetration Angle

This is the angle in which the airwaves reach a certain object they need to go through. The transmission to the other side of the object would be better as this angle gets closer to 90 °, being this the best transmission situation

In Figure 2.4a it is shown a receiver in a situation where the penetration angle is too close to 0° . The solution to that problem can be seen in Figure 2.4b using a repeater in a different position

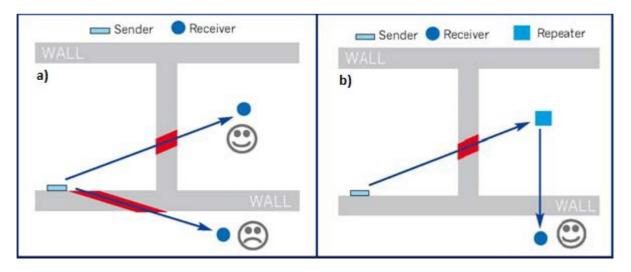


Figure 2.4 Penetration angle

2.2.3 Distance between Receiver and sources of interference

The distance between EnOcean receivers, as it is the STC-MITSUBISHI A/C, and other transmitters (e.g. GSM / DECT / wireless LAN) or high frequency sources of interference (computers, audio and video equipment) should be higher than 50 centimetres.

However, EnOcean transmitters can be installed next to any other high-frequency transmitters without any problem.

2.2.4 Use of repeaters

In case of a poor radio reception, it may be helpful to use a repeater. EnOcean repeaters do not require any configuration, only a line-power supply is needed. A poor radio signal is received, refreshed and transmitted again, so nearly a double radio range can be achieved. Special EnOcean repeaters which can be switched to 2-level function allow two repeaters to be cascaded.

3. Configuration

The STC-MITSUBISHI A/C (Figure 3.1) has two switches, a button and a profile selector to execute the Learning and Teach-in procedures from the EnOcean technology (explained in Table 3.1 and the following sections)

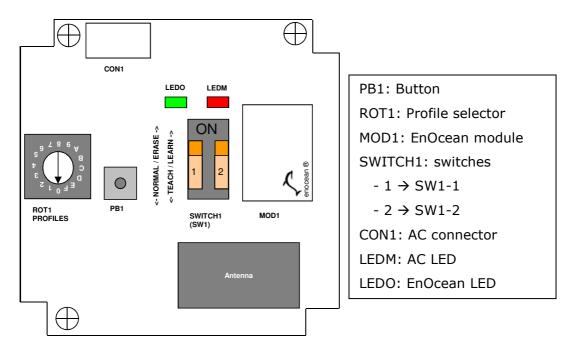


Figure 3.1 Device diagram

The switches in SW1 configure the behaviour of the interface. The different working modes are explained in Table 3.1.

Mode	Switch 1 (SW1-1)	Switch 2 (SW1-2)	EnOcean LED state	Button PB1 function
Normal operation / Teach-in	Off	Off	Off	Send a Teach-in telegram or activate monitor mode (pressing it during 5 seconds)
EnOcean transmission disabled. Only allows Teach-in	Off	On	Off	Send a Teach-in telegram or activate monitor mode (pressing it during 5 seconds)
Learning	On	Off	On	No function
Erase	On	On	Flashing: 100 ms On / 100 ms Off	Delete the devices in the selected profile (pressing it during 5 seconds)

Table 3.1 Interface working modes.

Selector ROT1 it is used to select the desired profile. The transmission profile is used when the device is in Teach-in mode and the reception one when in Learning or erase mode.

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 9 of 31

3.1. *Learning procedure*

The interface STC-MITSUBISHI A/C has, by default, 11 reception (Rx) profiles. In the factory configuration each Rx profile is assigned to a control signal of the Mitsubishi Electric AC indoor unit. The Learning procedure allows to link EnOcean devices to control the AC. Up to 5 devices can be linked to each profile (see exceptions in Table 3.2).

The profiles are as follow:

Profile Index Rx (ROT1)	Signal	Allowed devices in profile
0	On/Off	5
1	Mode	5
2	Fan Speed	5
3	Vane position	5
4	Set point Temperature ¹	5
5	Ambient Temperature (virtual) ²	1
6	Window contact	5
7	KEY CARD ³	1
8	Occupancy sensor	5
9 a D	N/A	N/A
E	A.C profile	5
F	A.C profile ³	5

Table 3.2 Default reception profiles

To **execute** the **Learning** procedure the next steps need to be followed. References to device components refer to Figure 3.1:

- 1. Set switch 1 (SW1-1) to ON position and switch 2 (SW1-2) to OFF. The EnOcean LED will be ON.
- 2. Set the profile selector (ROT1) in the desired position to link the EnOcean transmitters to the reception profile.
- 3. Push the Teach-in button of the devices that want to be linked, or if they don't have the Teach-in button (as the EnOcean switches) action them
- 4. When a valid EnOcean telegram is received the EnOcean LED turns off for 100 milliseconds and then it turns on again. The maximum linked devices in one profile is 5 (check Table 3.2 for special cases). Once this number is reached, no more devices are going to be linked to that profile. The EnOcean LED turns off when that happens.
- 5. Once the Learning procedure is finished set both SW1-1 and SW1-2 to off for a normal operation of the device. Once that is done the EnOcean LED turns off.

¹ When the Virtual temperature is turned on the set point temperature to be written to the AC unit is the virtual temperature instead of the Set point temperature.

 $^{^2}$ When a device is linked to either of these profiles the virtual temperature function is turned on automatically and the other is disabled so only one temperature reference can be linked. When no device linked it turns off.

³ Only one device can be linked to this profile

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 10 of 31

Profile	Supported EEP
Index Rx	
(ROT1)	
0	[05-02-xx] [05-03-xx] [06-00-01] [07-10-01] [07-10-02] [07-10-05]
1	[05-02-xx] [05-03-xx]
2	[05-02-xx] [05-03-xx] [07-10-01] [07-10-02] [07-10-04] [07-10-07]
	[07-10-08] [07-10-09]
3	[05-02-xx]
4	[05-02-xx] [05-03-xx] [07-10-01] [07-10-02] [07-10-03] [07-10-04]
	[07-10-05] [07-10-06] [07-10-0A] [07-10-10] [07-10-11] [07-10-12]
5	[07-02-05][07-02-06][07-10-01][07-10-02][07-10-03][07-10-04]
	[07-10-05] [07-10-06] [07-10-07] [07-10-08] [07-10-09] [07-10-0A]
	[07-10-0B] [07-10-0C] [07-10-0D] [07-10-10] [07-10-11] [07-10-12]
	[07-10-13] [07-10-14]
6	[05-02-xx] [05-03-xx] [06-00-01] [07-30-02]
7	[05-04-01]
8	[07-07-01] [07-08-01] [07-08-02]
E	$[07-20-10][07-10-03][07-20-11]^1$
F	$[07-20-10][07-10-03][07-20-11]^1$

Table 3.3 STC-MITSUBISHI A/C supported reception EEP

Important!

In Profiles E and F up to 5 devices can be linked. It needs to be taken into account that if the devices are working in Multiteach-in mode (more information in 4.5) only one is going to be fully linked as it would take 3 of the 5 spaces available.

¹ HVAC Components (FUNC = 20) Generic HVAC interface (TYPE = 10 and 11) explained in section **Fehler! Verweisquelle konnte nicht gefunden werden.** and in EnOcean Equipment Profiles (EEP) and V2.1

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 11 of 31

3.2. Teach-in procedure

The STC-MITSUBISHI A/C , as a transmitter device, has the Teach-in procedure implemented. With this procedure the AC can be linked to other EnOcean devices accepting the data send by the ME-AC-ENO.

There are several transmission profiles by default, with several AC signals assigned to them. The send data would contain the state of the AC signals specified in Table 3.4

Profile Index Tx	Transmission signals	EEP (EnOcean
(ROT1)		Profile)
0	On/Off	[05-02-01]
1	Alarm State	[05-02-01]
2	Set point Temperature	[07-02-05]
3	Ambient Temperature	[07-02-05]
4	Ambient Temperature, Set point Temperature, Fan Speed, On/Off	[07-10-01]
5	AC interface: Mode, fan speed, vane position, sensors and On/Off	[07-20-10]
6	Set point Temperature, Ambient Temperature	[07-10-03]
7	AC interface: AC Error code, Error state and disablements	[07-20-11]
8 to D	N/A	
E	All	[07-20- 10] ¹ [07-10-03] [07-20-11]
F	All	[07-20- 10] ¹ [07-10-03] [07-20-11]

Table 3.4 Signals linked to ROT1 (Figure 3.1)

To **execute** the **Teach-in** procedure:

- 1. Set the switches SW1-1 and SW1-2 to OFF
- 2. Set the profile selector (ROT1) to the desired transmission profile for the Teach-in procedure
- 3. Press PB1 to send a teach-in telegram. There must be a receiving in Learning mode for the linking to happen.

Remember that in this procedure the STC-MITSUBISHI A/C interface doesn't keep information from any of the devices.

Important!

In Profiles E and F three EEP's are sent pressing PB1 only once. These EEP's are sent with three different Base ID and therefore they behave in fact as 3 different devices. More information in section 4.5.

¹ Multiteach-in process: The three EEp's are sent one after the other pressing the teach-in button only once.

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 12 of 31

3.3. *Device deleting procedure*

To delete one or all the devices linked in one reception profile (Table 3.2) the device needs to be in ERASING mode. To do so follow the following lines (the references to device components are specified in Figure 3.1):

- 1. Set the profile selector (ROT1) to the desired reception profile where the device/s to be deleted are saved.
- 2. Set the switches SW1-1 and SW1-2 to ON. The EnOcean LED (LEDO) will turn into flashing (100 ms on and 100ms off)
- 3. Push the Teach-in button of the devices that want to be linked, or if they don't have the Teach-in button (as the EnOcean switches) action them. Once the telegram is received the EnOcean LED will be on for 1 second to show the device has been deleted from this profile.
- 4. Once finished, set the switches SW1-1 and SW1-2 to OFF for a normal operation of the device

A device can break down or be lost, and therefore the above mentioned delete procedure would not be possible to be executed. For that reason all the devices in one profile can be deleted. To do so follow the instructions (the references to device components are specified in Figure 3.1):

- 1. Set the profile selector (ROT1) to the desired reception profile.
- 2. Set the switches SW1-1 and SW1-2 to ON. The EnOcean LED (LEDO) will turn into flashing (100 ms on and 100ms off)
- 3. Press the button PB1 for 5 seconds. Once that is done the EnOcean LED (LEDO) will be on for 1 second to show that all devices in this profile have been deleted.
- 4. Once finished, set the switches SW1-1 and SW1-2 to OFF for a normal operation of the device

4. Special Behaviours

In this section it is explained the special behaviour of the STC-MITSUBISHI A/C when certain kinds of devices are used: Window contacts, thermostat with external temperature sensor, occupancy sensors and key card. The use of these sensors needs further explanation as the STC-MITSUBISHI A/C realizes special operations or assume previous states. All the explanations in these sections are related to the factory settings of the device.

4.1. Window contact

The STC-MITSUBISHI A/C has the functionality to automatically control the turning on and off of the AC indoor unit depending on the state of one or several (up to 5) EnOcean window contacts.

EnOcean window contacts periodically send its state and they do so too after a change in the window state happens.

When a window contact is associated to the STC-MITSUBISHI A/C interface it is assumed that the window is closed until the correct state of the window contact is received.

The AC indoor unit will be turned OFF and disabled if **any** of the window contacts linked to the window contact profile is sending a "window opened" message for a certain period of time (default value: 30 seconds). If the AC indoor unit is set to ON (either by an EnOcean device of by the remote control) the STC-MITSUBISHI A/C will set it back to OFF.

When all the window contacts are sending a "window closed" message, the AC indoor unit will go back to its previous state.

The functionality specified on the above lines would only be active when devices are linked in the window contact profile (Table 3.2).

The information about the states of the linked window contacts would be lost if there is a power down in the system, but it will restore itself in a brief period of time as the window contacts send their state periodically.

4.2. External temperature Sensors. Virtual temperature

The AC indoor units have an internal temperature sensor that it is used to reach the set point temperature.

This sensor is normally placed in the return pipe or in a position that does not matches where the thermostat is placed. That can create an issue as the AC unit and the thermostat are not measuring the same ambient temperature.

There is the possibility to place an EnOcean thermostat with its own temperature sensor and be wanted to use this temperature to control the AC unit and not the internal AC sensor. It is then when it appears the virtual temperature concept.

This behavior is only activated when there is an external temperature device linked to either profile 5 or profile F. Once a device is linked to one of these profiles the other is going to be disabled as the AC unit can only work with one external temperature as a reference.

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 14 of 31

Four temperatures are involved:

- Set point temperature: It is the set point temperature sent to the AC unit (*S*)
- Ambient temperature: It is the ambient temperature measured by the AC (*T*) unit
- Virtual Set point temperature: It is the Set point temperature requested by (S_{ν}) the thermostat
- Virtual Ambient temperature: It is the ambient temperature measured by the (T_{ν}) thermostat

The way to solve this situation is to know which Set point temperature needs to be send to the AC unit, so it regulates its own behaviour with the external thermostat temperature.

For that to happen, the difference between the Set point temperature and the ambient temperature needs to be the same as the difference between the Thermostat set point temperature and the thermostat ambient temperature. Doing so, when the temperature measured by the thermostat reaches the set point temperature of the thermostat, the difference between the temperature measured in the AC and its Set point temperature would be zero as it is shown in the formula below:

$$S - T = S_v - T_v$$

From this formula we can then obtain the Set point temperature to be sent to the A.C:

$$S = T + S_v - T_v$$

The maximum and minimum of the AC Set point temperature need to be respected. That's why if the value obtained in the above formula it is higher or lower than these values it is saturated to the corresponding limit.

4.3. Key Card reader

Due to the way the Key Cards reader work there is a specific reception profile for it. In this profile (Table 3.2) it is only possible to link one device. If the linked device it is not a key card the correct behaviour of the ME-AC-ENO-1/ cannot be granted.

When inserting the Key card in the reader the A.C unit is enabled (becomes available to be turned on) but it stays OFF. A manual actuation of another device would be needed to turn it ON.

When the Key card is removed the A.C indoor unit is disabled and turned OFF staying in this state until we insert the Key Card again. If the AC indoor unit is set to ON (either by an EnOcean device of by the remote control) the STC-MITSUBISHI A/C will set it back to OFF.

The functionality specified on the above lines would only be active when devices are linked in the Key Card profile (Table 3.2).

The information about the state of the linked key card would be lost if there is a power down in the system. Therefore it would be needed to set the previous state by actuating the key card.

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 15 of 31

4.4. Occupancy sensors

The STC-MITSUBISHI A/C has the functionality to automatically control the behaviour of the AC indoor unit depending on the state of one or several (up to 5) EnOcean Occupancy sensors.

When all the occupancy sensors linked to the device are not detecting any occupancy the STC-MITSUBISHI A/C will go to non-presence mode following these steps:

- 1. Wait a certain time period (default value: 10 minutes) where no action is performed.
- 2. When this time expires the temperature will change depending on the mode. If in Cool the set point would increase 2°C and if in Heat would decrease 2°C. If any other mode the set point temperature would not be changed.
- 3. This would last for a certain period of time (default value: 60 minutes) when the machine would be turned OFF.

If a presence is detected the system will work as follows:

- 1. If in step 1 or 2: go to the previous state.
- 2. If in Step 3: do nothing.

The information about the state of the linked Occupancy sensors would be lost if there is a power down in the system. It will recover as soon as a presence signal is received.

4.5. *MultiTeach-in procedure*

AC units have a lot of parameters to control and supervise and with only one 4BS telegram all this information cannot be fitted in. For these reason the STC-MITSUBISHI A/C implements, besides standard teach-in, a MultiTeach-in procedure where more than one EEP is sent to be teach at the same time. In the next lines this procedure is going to be further explained.

This procedure is performed only when the profile selector (ROT1) is set to profiles E or F (the ones that implement the HVAC generic EEPs). The way it is implemented is simple. A different Base ID is assigned to each EEP and it is actually performing 3 consecutive teach-in procedures. This allows devices that support the 3 EEP's to automatically link them.

It needs to be taken into account that used in this profile the ME -AC-ENO-1 / is working as if it was three different EnOcean devices at a time.

If this procedure is performed in the opposite way (the ME -AC-ENO-1 / is in Learning mode in profile E or F) 3 devices positions would be taken, implying that only 1 device using MultiTeach-in would be able to be fully link in each profile. If tried again with another device only 2 of the different EEPs are going to be stored.

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 16 of 31

5. Communications monitoring

The interface STC-MITSUBISHI A/C has two LEDs that show information about the operation of the device.

The green LED is associated to the EnOcean section, and the red LED to the Mitsubishi Electric Air Conditioner one (AC LED)

5.1. AC communication monitoring mode (RED LED)

In Table 5.1 it is shown how the AC LED (red) behaves and its meaning

Device state	LEDM (RED) state	ON / OFF Period	Meaning
Turning on	Pulse	On during 5 seconds	Reset or initialization process after start up
During normal operation	Flashing	200ms On 800ms Off	Communication error with A.C. unit
During normal operation	Flashing	1s On 1s Off	Error detected in A.C. unit
During normal operation	Off	-	Normal operation in the A.C communication

Table 5.1 Device estate and AC LED

5.2. EnOcean communication monitoring mode (GREEN LED)

Due to the transmitting method (radio) of EnOcean telegrams, the possibility that the STC-MITSUBISHI A/C is outside the coverage range of one device is possible. For that reason, the interface, as a receiver, has the ability to show when it receives EnOcean telegrams when in monitoring mode.

To **activate** the monitoring mode:

- 1. Set switches SW1-1 y SW1-2 to OFF
- 2. Press PB1 for 6 seconds. The EnOcean LED will briefly flash (100ms). From then on, the EnOcean LED will flash every time a valid EnOcean Telegram is received from a linked device to the STC-MITSUBISHI A/C

To **disable** the monitoring mode:

1. Briefly push (less than 6 seconds) PB1

6. Technical data and dimensions

The main features of the devices STC-MITSUBISHI A/C are shown in Table 6.1. For further detail check the STC-MITSUBISHI A/C datasheet

Dimensions	71 x 71 x 27 mm
Weight	60 g
Operating Temperature	-25 85°C
Stock Temperature	-40 85°C
Operating Humidity	<93% HR, non-condensing
Stock Humidity	<93% HR, non-condensing
Power requirements	12V, 35mA typical
EnOcean Frequencies	ME-AC-ENO-1: 868 MHz
	ME-AC-ENO-: 315 MHz

Table 6.1 Technical data

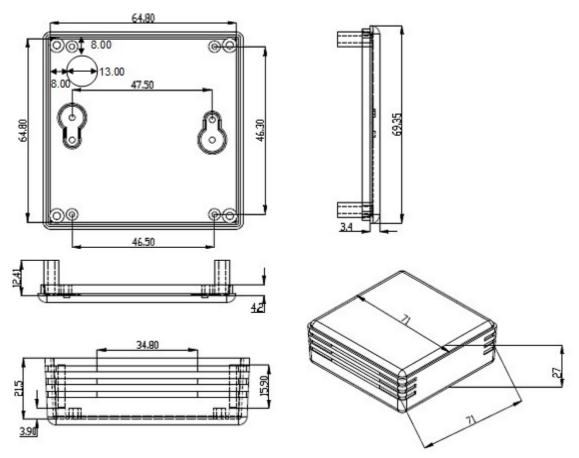


Figure 6.1 Device Dimensions

7. A.C profile data (Generic HVAC interface)

In this section the *Generic HVAC interface* EEPs (07-20-10 and 07-20-11) applied to the STC-MITSUBISHI A/C are explained. These two EEPs along with the *Room Operating Panel* EEP 07-10-03 can transmit and receive all the AC information.

HVAC Components

ORG = 07 (4 BS) FUNC = 20 HVAC Components

EEP: 07-20-10

TYPE = 10 Generic HVAC interface – Functions: Mode, vane position, fan speed, sensors and on/off

EEP for Generic HVAC interface – Functions: Mode, vane position, fan speed, sensors and on/off: With this EEP plus the already existing EEP 07-10-03 and 07-20-11 all the information of AC indoor unit can be sent and received allowing a much easier and complete control of these units.

<u>Teach-In</u>

The teach-in telegram has the same structure as a normal 4BS telegram. see. Standardization EnOcean Equipment Profiles (EEP) V2.0 The actuator expected after successful teach-in a 4BS teach-in acknowledge and use the following structure.

DB_3 DB_2							DB_1									DB_0												
765	5 4	3	2	1 0	7	6	5	4	3	2	1	0	7	6	5	4	3	2	1	0	7	6	5	4	3	2	1	0
Profile	e			Тур	e					Ma	an	uf	ac	tu	rer	· II	D				LRN Type		LRN result	TA	LRN	d.c	d.c	d.c

DB_3:	Function, same as tea	ich-in telegram neating valve = 20
DB_2:	type, same as teach-i	n telegram actuator = 01
DB_1:	Intesis Software ID:19)
DB_0.BIT_7:	LRN TYPE = 0b1 (type	1 with profile, manufacturer Id)
DB_0.BIT_6:	EEP result; EEP suppo	rted = 0b1, EEP not supported = 0b0
DB_0.BIT_5:	LRN result; ID stored	= 0b1, ID deleted (not stored) = 0b0
DB_0.BIT_4:	TA= teach in answer =	= 0b1
DB_0.BIT_3:	LRN Learn button	0b0 Teach-in telegram
		0b1 Data telegram
DB_0.BIT_2:	not used	
DB_0.BIT_1:	not used	
DB_0.BIT_0:	not used	

EEP: 07-20-10 (CONTINUATION)

DATA BYTES

<u>Receive mode</u>: Commands received by the HVAC interface

DB_3	Mode ¹	0 1 3 9 14 33 254 255	Auto Heat Cool Fan only Dehumidification (dry) reserved N/A ²
DB_2 [7 4]	Vane position	0 1 2 3 4 5 6 7 14 15	Auto Horizontal Pos2 Pos2 Pos4 Vertical Swing Not supported N/A
DB_2 [3 0]	Fan Speed	0 1 2 3 4 514 15	Auto Low Mid1 Mid2 High Sets the value to High N/A
DB_1	Not used		,
DB_0.BIT_3	Learn Button	0b0 0b1	Teach-in telegram Data telegram
DB_0_DB2+ DB_0_DB1:	Room occupancy	00: 01: 10: 11:	Occupied StandBy (waiting to perform action) Unoccupied (action performed) Off (no occupancy and no action)
DB_0.BIT_0)	On/Off	0b0 0b1	Off turns the unit to Off On

 $^{^1}$ Other modes don't apply to this AC interface. If any other received it would behave as if it had received and N/A 2 N/A stands for No Action. It keeps the actual value of the parameter

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 20 of 31

EEP: 07-20-10 (CONTINUATION)

DB_3	Mode ¹	0 1 3 9 14 33 254 255	Auto Heat Cool Fan only Dehumidification (dry) reserved N/A ²
DB_2 [7 4]	Vane position	0 1 2 3 4 5 6 7 14 15	Auto Horizontal Pos2 Pos2 Pos4 Vertical Swing Not supported N/A
DB_2 [3 0]	Fan Speed	0 1 2 3 4 514 15	Auto Low Mid1 Mid2 High Sets the value to High N/A
DB_1	Not used		
DB_0.BIT_3	Learn Button	0b0 0b1	Teach-in telegram Data telegram
DB_0_DB2+ DB_0_DB1:	Room occupancy	00: 01: 10: 11:	Occupied StandBy (waiting to perform action) Unoccupied (action performed) Off (no occupancy and no action)
DB_0.BIT_0)	On/Off	0b0 0b1	Off On

Transmit mode: Commands sent by the HVAC interface

 2 N/A: it is send when the actual value of the parameter is not known

 $^{^{1}% \}left(\mathcal{A}^{\prime}\right) =0$ Other modes don't apply to this AC interface. It will only send this ones

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - <u>email@thermokon.de</u> produktblatt_stc_mitsubishi_ac_eng ©2011 Page 21 of 31

EEP: 07-20-11

TYPE = 11 Generic HVAC interface – Error control: AC Error code, Error states and disablements

EEP for Generic HVAC interface – Functions: Mode, vane position, fan speed, sensors and on/off: With this EEP plus the already existing EEP 07-10-03 and 07-20-10 all the information of AC indoor unit can be sent and received allowing a much easier and complete control of these units.

<u>Teach-In</u>

The teach-in telegram has the same structure as a normal 4BS telegram. see. Standardization EnOcean Equipment Profiles (EEP) V2.0 The actuator expected after successful teach-in a 4BS teach-in acknowledge and use the following structure.

DB_3	DB_2	DB_1	DB_0						
765432	1076543	2 1 0 7 6 5 4 3 2 1 0	7 6	5	4	3	2	1	0
Profile	Туре		LRN EEP Type resu	LRN It result		LRN	d.c	d.c	d.c

DB_3:	Function, same as teach-	in telegram heating valve = 20
DB_2:	type, same as teach-in te	legram actuator = 01
DB_1:	Intesis Software ID:19	
DB_0.BIT_7:	LRN TYPE = 0b1 (type 1 w	vith profile, manufacturer Id)
DB_0.BIT_6:	EEP result; EEP supported	d = 0b1, EEP not supported = 0b0
DB_0.BIT_5:	LRN result; ID stored = 0	o1, ID deleted (not stored) = 0b0
DB_0.BIT_4:	TA= teach in answer = 0b	1
DB_0.BIT_3:	LRN Learn button	0b0 Teach-in telegram
		0b1 Data telegram
DB_0.BIT_2:	not used	
DB_0.BIT_1:	not used	
DB_0.BIT_0:	not used	

EEP: 07-20-11 (CONTINUATION)

DATA BYTES

<u>Receive mode</u>: Commands received by the HVAC interface DB 3 not used DB 2 not used DB_1 [7 .. 1] not used DB_1.BIT_0 External disablement 0b0 Not disabled 0b1 Disabled DB_0.BIT_3 Learn Button 0b0 Teach-in telegram 0b1 Data telegram Disable remote controller DB_0.BIT_2 Not supported DB 0.BIT 1 Window contact 0b0 Windows opened 0b1 Windows closed DB_0.BIT_0 not used Transmit mode: Commands sent by the HVAC interface DB_3 Error code HI Generated by A.C (Table 10.1) DB_2 Error code LO Generated by A.C (Table 10.1) DB_1 [7 .. 4] Reserved 0x00 DB_1.BIT_3 Other disablement 0b0 Not Used DB_1.BIT_2 Window contact disablement 0b0 Not disabled 0b1 Disabled Key card disablement Not disabled DB 1.BIT 1 0b0 0b1 Disabled DB_1.BIT_0 External disablement 0b0 Not disabled 0b1 Disabled DB_0.BIT_3 Learn Button 0b0 Teach-in telegram 0b1 Data telegram DB_0.BIT_2 Remote controller Disablement 0b0 Not supported Window contact DB_0.BIT_1 0b0 Windows opened 0b1 Windows closed DB_0.BIT_0 Alarm State 0b0 OK 0b1 Error

8. AC Unit Types compatibility

The AC indoor unit models specified in Table 8.1 are the ones compatible with the devices STC-MITSUBISHI A/C .

Prefix (first part) of the AC indoor	Line
unit model number	
MFZ-KA	Domestic
MLZ-KA	Domestic
MSZ-FA	Domestic
MSZ-FD	Domestic
MSZ-GA22, MSZ-GA25, MSZ-GA35	Domestic
MSZ-GA50, MSZ-GA60, MSZ-GA71	Domestic
MSZ-GB	Domestic
MSZ-GC	Domestic
MSZ-GE	Domestic
MSZ-SF	Domestic
PCA-RP GA	Mr Slim
PCA-RP KA	Mr Slim
PEA-RP200	Mr Slim
PEA-RP400	Mr Slim
PEAD-JA	Mr Slim
PEAD-RP	Mr Slim
PEFY-P20-140VMA-E	City Multi
PEH-RP200-250	Mr Slim
PKA-RP35-50HAL	Mr Slim
PKA-RP60-71-100KAL	Mr Slim
PKA-RP100FAL	Mr Slim
PLA-RP AA2	Mr Slim
PLA-RP BA	Mr Slim
PSA	Mr Slim
SEZ-KA	Mr Slim
SEZ-KD	Mr Slim
SLZ-KA	Mr Slim

Table 8.1 AC Unit Types compatibility

Any AC unit with a model number not specified in this list (in column *Prefix*), might not be compatible with the interface and therefore can't be used without previously checking the model compatibility, contact your STC-MITSUBISHI A/C supplier for this.

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 24 of 31

9. Available features for each type of Mitsubishi Electric AC Unit.

Supported Mitsubishi Electric AC unit models will differ from each other in the features they offer, with regard to following functionalities:

- Number of different operation modes
- Number of different fan speeds
- Number of different vane positions
- Range of temperature set points, which may also depend on the mode of operation of the unit (heat, cool, ...)

In case that signals as *operation mode, fan speed, vane position* or *temperature setpoints* are written to a value that is not supported by the AC unit under control, the AC unit will ignore the setting. In general, this situation should be avoided: <u>only those values supported</u> by the AC unit under control should be written in the appropriate signal.

This list shows the available features in each supported Mitsubishi Electric AC type.

MFZ-KA			Temperature Set Point			
Mode	Fan	Vane	Heat Cool Dry Auto			
HEAT, DRY, COOL, AUTO	AUTO, LOW, MID1, MID2, HIGH	0,1,2,3,4,5,6	1631	1631	1631	1631

MLZ-KA			Temperature Set Point			
Mode	Fan	Vane	Heat Cool Dry Auto			
HEAT, DRY, COOL, AUTO	AUTO, LOW, MID1, MID2	0,1,2,3,4,5,6	1631	1631	1631	1631

MSZ-FA			Temperature Set Point			
Mode	Fan	Vane	Heat Cool Dry Auto			
HEAT, DRY, COOL, AUTO	AUTO, LOW, MID1,MID2	0,1,2,3,4,6	1631	1631	1631	1631

MSZ-FD			Temperature Set Point			
Mode	Fan	Vane	Heat Cool Dry Auto			Auto
HEAT, DRY, COOL, AUTO	AUTO, LOW, MID1, MID2, HIGH	0,1,2,3,4,5,6	1631	1631	1631	1631

MSZ-GA22, MSZ-GA25, MSZ-GA35			Temperature Set Point			
Mode	Fan	Vane	Heat Cool Dry Auto			Auto
HEAT, DRY, COOL, AUTO	AUTO, LOW, MID1,MID2	0,1,2,3,4,5,6	1631	1631	1631	1631

MSZ-GA50, MSZ-GA60, MSZ-GA71			Temperature Set Point			
Mode	Fan	Vane	Heat Cool Dry Auto			
HEAT, DRY, COOL, AUTO	AUTO, LOW, MID1,MID2	0,1,2,3,4,5,6	1631	1631	1631	1631

MSZ-GB			Temperature Set Point			
Mode	Fan	Vane	Heat Cool Dry Auto			
HEAT, DRY, COOL, AUTO	AUTO, LOW, MID1, MID2	0,1,2,3,4,6	1631	1631	1631	1631

MSZ-GC			Temperature Set Point			
Mode	Fan	Vane	Heat Cool Dry Auto			
HEAT, DRY, COOL, AUTO	AUTO, LOW, MID1, MID2, HIGH	0,1,2,3,4,5,6	1631	1631	1631	1631

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 25 of 31

MSZ-GE				Temperature Set Point			
Mode Fan Vane			Heat	Cool	Dry	Auto	
HEAT, DRY, COOL, AUTO	AUTO, LOW, MID1, MID2, HIGH	0,1,2,3,4,5,6	1631	1631	1631	1631	

MSZ-SF				Temperature Set Point			
Mode Fan Vane				Cool	Dry	Auto	
HEAT, DRY, COOL, AUTO	AUTO, LOW, MID1, MID2, HIGH	0,1,2,3,4,5,6	1631	1631	1631	1631	

PCA-RP GA				Temperature Set Point				
Mode	ode Fan Vane Heat Cool D					Auto		
HEAT, DRY, COOL, FAN, AUTO	LOW, MID1, MID2, HIGH [*]	1,3,4,5,6	1728	1930	1930	1928		
*HIGH appendiment has available in some older versions of this AC type								

*HIGH speed may not be available in some older versions of this AC type

PCA-RP KA				Temperature Set Point			
Mode	Fan	Vane	Heat	Cool	Dry	Auto	
HEAT, DRY, COOL, FAN, AUTO	AUTO, LOW, MID1, MID2, HIGH	0,1,2,3,4,5,6	1728	1930	1930	1928	

PEA-RP200			Temperature Set Point			
Mode Fan Vane				Cool	Dry	Auto
HEAT, DRY, COOL, FAN, AUTO	LOW, MID2	(no vanes)	1728	1930	1930	1928

PEA-RP400			Temperature Set Point			
Mode	Node Fan Vane Heat Cool Dry A					Auto
HEAT, DRY, COOL, FAN, AUTO	(single fan speed)	(no vanes)	1728	1930	1930	1928

PEAD-JA			Temperature Set Point			
Mode Fan Vane				Cool	Dry	Auto
HEAT, DRY, COOL, FAN, AUTO	AUTO, LOW, MID1, MID2	(no vanes)	1728	1930	1930	1928

PEAD-RP			Temperature Set Point			
Mode Fan Vane			Heat	Cool	Dry	Auto
HEAT, DRY, COOL, FAN, AUTO	LOW, MID2	(no vanes)	1728	1930	1930	1928

PEFY-P20-140VMA-E				Temperature Set Point			
Mode	Fan	Vane	Heat	Cool	Dry	Auto	
HEAT, DRY, COOL, FAN, AUTO*	AUTO, LOW, MID1, MID2	(no vanes)	1728	1930	1930	1928	
* AUTO operation mode is only availa	ble when using outdoor units PURY	or PQRY					

PEH-RP200-250			Temperature Set Point			
Mode	Mode Fan Vane				Dry	Auto
HEAT, DRY, COOL, FAN, AUTO	(single fan speed)	(no vanes)	1728	1930	1930	1928

PKA-RP35-50HAL			Temperature Set Point			
Mode	Fan	Vane	Heat	Cool	Dry	Auto
HEAT, DRY, COOL, FAN, AUTO	AUTO, LOW, MID1, MID2	0,1,2,3,4,5,6	1728	1930	1930	1928

PKA-RP60-71-100KAL			Temperature Set Point			
Mode	Mode Fan Vane			Cool	Dry	Auto
HEAT, DRY, COOL, FAN, AUTO	AUTO, LOW, MID1, MID2	0,1,2,3,4,5,6	1728	1930	1930	1928

PKA-RP100FAL			Temperature Set Point			
Mode	Fan	Vane	Heat	Cool	Dry	Auto
HEAT, DRY, COOL, FAN, AUTO	LOW, MID2	1,3,4,5,6	1728	1930	1930	1928

PLA-RP AA2			-	Temperature Set Point			
Mode	Fan	Vane	Heat	Cool	Dry	Auto	
HEAT, DRY, COOL, FAN, AUTO	LOW, MID1, MID2	1,3,4,5,6	1728	1930	1930	1928	

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 26 of 31

PLA-RP BA			Temperature Set Point			
Mode	Fan	Vane	Heat	Cool	Dry	Auto
HEAT, DRY, COOL, FAN, AUTO	AUTO, LOW, MID1, MID2, HIGH	0,1,2,3,4,5,6	1728	1930	1930	1928

PSA		Temperature Set Point					
Mode	Fan	Vane	Heat	Cool	Dry	Auto	
HEAT, DRY, COOL, FAN, AUTO	LOW, MID2	(no vanes)	1728	1930	1930	1928	
SEZ-KA			-	Temperature Set Point			
Mode	Fan	Vane	Heat	Cool	Dry	Auto	
HEAT, DRY, COOL, FAN, AUTO	LOW, MID2	(no vanes)	1728	1930	1930	1928	
SEZ-KD			Temperature Set Point				
Mode	Fan	Vane	Heat	Cool	Dry	Auto	
HEAT, DRY, COOL, FAN, AUTO	AUTO, LOW, MID1, MID2	(no vanes)	1728	1930	1930	1928	
SLZ-KA			-	Temperat	ure Set F	oint	
Mode	Fan	Vane	Heat	Cool	Dry	Auto	
HEAT, DRY, COOL, FAN, AUTO	LOW, MID1, MID2	1,3,4,5,6	1728	1930	1930	1928	

10. Error Codes

0 No active error 1102 Discharge Temperature high 1118 Internal thermostat detector working (49C) 1110 Outdoor unit fail 1300 Pressure low 1301 Pressure low 1302 Pressure low 1303 Pressure low 1304 Protection against freeze or battery high temperature 1504 Protection against freeze or battery high temperature 1504 Protection against freeze or battery high temperature 1504 High pressure error (ball valve closed) 1505 Erroneous operation of drain pump 2506 Erroneous operation of drain pump 2507 Erroneous operation of drain pump 2508 Drain sensor anonaly (DS) 4010 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4112 Phase detection 4113 Anti-phase detection 4114 Phase opened in phase L 2r connector 5M opened 4115 Error in the anti-phase detection 4118 Error in the	Code	Description
11108 Internal Internal Internosital detector working (49C) 1110 Outdoor unit fail 1300 Pressure low 1301 Pressure low 1302 Pressure low 1303 Protection against freeze or battery high temperature 1504 Protection against freeze or battery high temperature 1504 Protection against freeze or battery high temperature 1504 Drever heating protection 1509 High pressure error (ball valve closed) 1500 Super heating anomaly due to low temp. of discharge. (TH4) 2500 Erroneous operation of drain pump 2503 Drain sensor anomaly (DS) 4000 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4102 Phase detection opened 4103 Anti-phase detection (electronic board) 4104 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4120 Cut due to over-current of compressor 4220 Voltage anomaly 4210 Cut due to over-current of compressor 42	0	
1110 Outdoor unit fail 1300 Pressure high (High pressure probe working 63H) 1302 Protection against freeze or battery high temperature 1504 Protection against freeze or battery high temperature 1504 Over heating protection 1509 High pressure error (ball valve closed) 1500 Erroneous operation of drain pump 2502 Erroneous operation of drain pump 2503 Drain sensor anomaly (DS) 4000 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4102 Phase detection opened 4103 Anti-phase detection opened 4104 Phase opened in phase 12 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4120 Voltage anomaly 4200 Voltage anomaly 4201 Cut due to over-current of compressor 4220 Voltage anomaly (TH8) 5101 Ambient temperature probe anomaly (TH4) 5102 Cond/Exap probe anomaly (TH5) 5103 Outdoor probe errorTH4 5104 Error detection in discharge	1102	Discharge Temperature high
1300 Pressure low 1302 Pressure high (High pressure probe working 63H) 1303 Protection against freeze or battery high temperature 1504 Dver heating protection 1505 Dver heating protection 1506 Dver heating protection 1507 Dver heating protection 1508 Dver heating protection 1509 Dver heating protection 1500 Erroneous operation of drain pump 2500 Erroneous operation of drain pump 2501 Drain sensor anomaly (DS) 4000 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4102 Phase detection 4103 Anti-phase detector (electronic board) 4104 Connector 49L opened 4118 Error in the anti-phase detector (electronic board) 4210 Cut due to over-current of compressor 4220 Voltage anomaly	1108	Internal thermostat detector working (49C)
1302 Pressure high (High pressure probe working 63H) 1503 Protection against freeze or battery high temperature 1504 Protection against freeze or battery high temperature 1504 Over heating protection 1509 High pressure error (ball valve closed) 1509 Erroneous operation of drain pump 2500 Erroneous operation of drain pump 2501 Erroneous operation of drain pump 2502 Erroneous operation of drain pump 2503 Drain sensor anomaly (DS) 4100 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4102 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4120 Cundector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH4) 5102 Cond/Evap probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe errorTH3	1110	Outdoor unit fail
1503 Protection against freeze or battery high temperature 1504 Protection against freeze or battery high temperature 1504 Over heating protection 1509 High pressure error (ball valve closed) 1520 Super heating anomaly due to low temp. of discharge. (TH4) 2500 Erroneous operation of drain pump 2503 Drain sensor anomaly (DS) 4030 Serial transmission error 4101 Compressor pause due to excess of current (initial block) 4102 Phase detection opened 4113 Anti-phase detection 4108 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4124 Connector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly (TH8) 5101 Ambient temperature anomaly (TH4) 5102 Cond/Evap probe anomaly (TH5) 5114 Error detection in discharge temperature 5105 Outdoor probe errorTH3 5106 Outdoor probe errorTH6 5107 Outdoor probe errorTH8 5202 Connector 63L opened <th>1300</th> <th>Pressure low</th>	1300	Pressure low
1504 Protection against freeze or battery high temperature 1504 Over heating protection 1509 High pressure error (ball valve closed) 1509 Erroneous operation of drain pump 2500 Erroneous operation of drain pump 2501 Erroneous operation of drain pump 2502 Erroneous operation of drain pump 2503 Drain sensor anomaly (DS) 4100 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (initial block) 4102 Phase detection opened 4103 Anti-phase detection 4104 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4120 Condector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature anomaly (TH5) 5102 Liquid probe anomaly (TH5) 5103 Outdoor probe errorTH6 5104 Error detection in discharge temperature 5107 Outdoor probe errorTH8 <th>1302</th> <th>Pressure high (High pressure probe working 63H)</th>	1302	Pressure high (High pressure probe working 63H)
1504 Over heating protection 1509 High pressure error (ball valve closed) 1520 Super heating anomaly due to low terms, of discharge. (TH4) 2500 Erroneous operation of drain pump 2501 Drain sensor anomaly (DS) 4030 Serial transmission error 4101 Compressor pause due to excess of current (initial block) 4102 Phase detection opened 4103 Anti-phase detection 4104 Phase detection opened 4118 Error in the anti-phase detector (electronic board) 4124 Connector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4220 Voltage anomaly (TH8) 5101 Ambient temperature anomaly (TH6) 5102 Cond-Evap probe anomaly (TH5) 5103 Euror detection in discharge temperature 5104 Error detection in discharge temperature 5105 Outdoor probe errorTH7 5106 Outdoor probe errorTH8 5202 Connector 631, opened 5300 Current probe error 6601 MNET tusmission error <th>1503</th> <th>Protection against freeze or battery high temperature</th>	1503	Protection against freeze or battery high temperature
1509 High pressure error (ball valve closed) 1520 Super heating anomaly due to low temp. of discharge. (TH4) 2500 Erroneous operation of drain pump 2503 Drain sensor anomaly (DS) 2604 Erroneous operation of drain pump 2505 Serial transmission error 4100 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4102 Phase detection opened 4103 Anti-phase detection 4104 Phase opened in phase L 2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4124 Connector 49L opened 4210 Cul due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH4) 5102 Cond/Evap probe anomaly (TH2) 5103 Outdoor probe error TH4 5104 Error detection in discharge temperature 5105 Outdoor probe error TH4 5106 Outdoor probe error TH4 5100 Outdoor probe error TH8	1504	
1520 Super heating anomaly due to low temp. of discharge. (TH4) 2500 Erroneous operation of drain pump 2503 Drain sensor anomaly (DS) 4030 Serial transmission error 4100 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4102 Phase detection opened 4103 Anti-phase detection opened 4104 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4124 Connector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Cond/Evap probe anomaly (TH2) 5103 Courdeor probe errorTH3 5104 Error detection in discharge temperature 5105 Outdoor probe errorTH6 5106 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error <th8< td=""> 5202 Connector 63L opened</th8<>	1504	
2500 Erroneous operation of drain pump 2502 Erroneous operation of drain pump 2503 Drain sensor anomaly (DS) 4000 Serial transmission error 4100 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4102 Phase detection opened 4103 Anti-phase detection 4104 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4114 Connector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Cond/Evap probe anomaly (TH2) 5104 Error detection in discharge temperature 5105 Outdoor probe errorTH3 5106 Outdoor probe errorTH4 5107 Cutdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6401 MNET duplicated address definition 6402	1509	
2502 Erroneous operation of drain pump 2503 Drain sensor anomaly (DS) 4030 Serial transmission error 4100 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4102 Phase detection opened 4103 Anti-phase detection opened 4104 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4120 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Cond/Evap probe anomaly (TH2) 5103 Cutdoor probe error TH3 5104 Error detection in discharge temperature 5105 Outdoor probe error TH6 5106 Cutdoor probe error TH6 5107 Outdoor probe error TH8 5202 Connector 63L opened 5300 Current probe error 6603 MNET Use prose 6604 MNET transmission error 6605 MNET trans		
2503 Drain sensor anomaly (DS) 4030 Serial transmission error 4100 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4102 Phase detection opened 4103 Anti-phase detection 4104 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4124 Connector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Liquid probe anomaly (TH2) 5103 Outdoor probe errorTH3 5104 Error detection in discharge temperature 5105 Outdoor probe errorTH4 5106 Outdoor probe errorTH6 5107 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6601 MNET time transmission error 6602 MNET time transmission error 6603 MNET timestission	2500	Erroneous operation of drain pump
4030 Serial transmission error 4100 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4102 Phase detection opened 4103 Anti-phase detection 4104 Connector state due to excess of current (overload) 4105 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Cond/Evap probe anomaly (TH5) 5103 Error detection in discharge temperature 5104 Error detection in discharge temperature 5105 Outdoor probe errorTH6 5110 Outdoor probe errorTH6 5110 Outdoor probe errorTH6 5202 Connector 63 opened 5300 Current probe error 6601 MNET Une transmission error 6602 MNET Une transmission error 6603 MNET turasmission error	2502	Erroneous operation of drain pump
4100 Compressor pause due to excess of current (initial block) 4101 Compressor pause due to excess of current (overload) 4102 Phase detection opened 4103 Anti-phase detection 4104 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4124 Connector 49L opened 4120 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Liquid probe anomaly (TH5) 5103 Outdoor probe error TH3 5104 Error detection in discharge temperature 5105 Outdoor probe errorTH7 5107 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6601 MNET tune transmission error 6602 MNET tune transmission error 6603 MNET tune transmission error 6604 MNET tunesmission error 6605 MNET tunesmission error 6606 MNET transmissi		
4101 Compressor pause due to excess of current (overload) 4102 Phase detection opened 4103 Anti-phase detection 4108 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4124 Connector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature probe anomaly (TH8) 5101 Armbient temperature probe anomaly (TH1), indoor unit 5102 Cond/Evap probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe errorTH6 5110 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET Unicated address definition 6602 MNET Unicated address definition 6603 MNET turasmission error 6604 MNET turasmission error 6607 MNET transmission error 6608 MNET transmission error 6608 MNET transmission error (reception e	4030	
4102 Phase detection opened 4103 Anti-phase detection 4108 Phase opened in phase 12 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4120 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Cond/Evap probe anomaly (TH2) 5103 Cond/Evap probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe error TH6 5107 Outdoor probe error TH8 5202 Connector 63L opened 5203 Current probe error TH8 5202 Connector 63L opened 5300 Current probe error TH8 6600 MNET Use tansmission hardware error 6603 MNET Use tansmission error 6604 MNET transmission error 6605 MNET transmission error 6606 MNET transmission error 6607 MNET transmission error 6608<		
4103 Anti-phase detection 4108 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4124 Connector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Liquid probe anomaly (TH2) 5103 Cond/Evap probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe error TH6 5110 Outdoor probe error TH6 5110 Outdoor probe error TH6 5110 Outdoor probe error TH6 5202 Connector 63L opened 5300 Current probe error 6600 MNET Line transmission hardware error 6602 MNET turb tack 6603 MNET transmission error 6604 MNET without cack 6605 MNET without response 6831 IR remote control transmission error (reception error) <t< th=""><th></th><th></th></t<>		
4108 Phase opened in phase L2 or connector 5M opened 4118 Error in the anti-phase detector (electronic board) 4124 Connector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Cond/Evap probe anomaly (TH2) 5103 Cond/Evap probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe errorTH3 5106 Outdoor probe errorTH6 5107 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET Line transmission error 6604 MNET transmission error 6605 MNET transmission error 6606 MNET transmission error 6607 MNET without ack 6608 MNET without ack 6608 MNET without response 6831		
4118 Error in the anti-phase detector (electronic board) 4124 Connector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Liquid probe anomaly (TH2) 5103 Cond/Evap probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe errorTH7 5107 Outdoor probe errorTH6 5107 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission error 6603 MNET Line transmission error 6604 MNET twithout ack 6608 MNET twithout response 6608 MNET without response 6608 MNET without response 68301 IR remote control transmission error (transmission error) 68401 Transmission error with the indoor/outdoor unit (reception err		
4124 Connector 49L opened 4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Liquid probe anomaly (TH2) 5103 Cond/Evap probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe error TH6 51107 Outdoor probe error TH6 5100 Outdoor probe error TH6 5101 Outdoor probe error TH6 5202 Connector 63L opened 5300 Current probe error TH8 5202 Connector 63L opened 5300 Current probe error TH8 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET transmission error 6604 MNET transmission error 6605 MNET without response 6611 IR remote control transmission error (reception error) 6832 IR remote control transmission error (reception error) <tr< th=""><th></th><th></th></tr<>		
4210 Cut due to over-current of compressor 4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Liquid probe anomaly (TH2) 5103 Liquid probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe error TH7 5107 Outdoor probe error TH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET Line transmission error 6604 MNET turb toxk 6605 MNET turb toxk 6606 MNET transmission error 6607 MNET without ack 6608 MNET without response 6831 IR remote control transmission error (reception error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (reception error) 6844 Error in inter-		
4220 Voltage anomaly 4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Cond/Evap probe anomaly (TH2) 5103 Error detection in discharge temperature 5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe error TH6 5110 Outdoor probe error TH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET transmission error 6607 MNET without response 6608 MNET without response 6831 IR remote control transmission error (reception error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (ransmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6844 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) <th></th> <th></th>		
4230 Radiator panel temperature anomaly (TH8) 5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Liquid probe anomaly (TH2) 5102 Cond/Evap probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe error TH7 5107 Outdoor probe error TH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET transmission error 6607 MNET transmission error 6608 MNET transmission error 6608 MNET without ack 6608 MNET without response 6831 IR remote control transmission error (reception error) 6841 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6844 Error i		
5101 Ambient temperature probe anomaly (TH1), indoor unit 5102 Liquid probe anomaly (TH2) 5102 Cond/Evap probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe error TH6 5107 Outdoor probe error TH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET transmission error 6607 MNET transmission error 6608 MNET transmission error 6608 MNET transmission error 6608 MNET transmission error 6631 IR remote control transmission error (reception error) 6832 IR remote control transmission error (reception error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (rassinsion error) 6844 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6844 Err		
5102 Liquid probe anomaly (TH2) 5102 Cond/Evap probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe errorTH7 5107 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET duplicated address definition 6603 MNET BUS busy 6606 MNET ture transmission hardware error 6607 MNET ture transmission error 6608 MNET transmission error 6608 MNET transmission error 6608 MNET transmission error 6608 MNET without ack 6608 MNET without response 6831 IR remote control transmission error (reception error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (reception error) 6844 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated <th></th> <th></th>		
5102 Cond/Evap probe anomaly (TH5) 5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe errorTH7 5107 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET without ack 6607 MNET without ack 6608 MNET transmission error 6608 MNET transmission error 6608 MNET without ack 6608 MNET without ack 6608 MNET without response 6831 IR remote control transmission error (reception error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (reception error) 6844 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
5104 Error detection in discharge temperature 5105 Outdoor probe error TH3 5106 Outdoor probe errorTH7 5107 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET tine transmission error 6607 MNET without ack 6608 MNET transmission error 6608 MNET transmission error 6608 MNET transmission error 6608 MNET without ack 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
5105 Outdoor probe error TH3 5106 Outdoor probe errorTH7 5107 Outdoor probe errorTH6 5110 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET transmission error 6607 MNET transmission error 6608 MNET transmission error 6608 MNET without ack 6608 MNET transmission error (reception error) 6831 IR remote control transmission error (reception error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
5106 Outdoor probe errorTH7 5107 Outdoor probe errorTH6 5110 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET Line transmission error 6607 MNET transmission error 6608 MNET without ack 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (treception error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
5107 Outdoor probe errorTH6 5110 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET Line transmission error 6607 MNET transmission error 6608 MNET without ack 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (reception error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (reception error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
5110 Outdoor probe errorTH8 5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET Line transmission error 6607 MNET transmission error 6608 MNET without ack 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated <		
5202 Connector 63L opened 5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET Line transmission error 6607 MNET transmission error 6608 MNET without ack 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
5300 Current probe error 6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET Line transmission error 6607 MNET transmission error 6608 MNET without ack 6608 MNET transmission error 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
6600 MNET duplicated address definition 6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET transmission error 6607 MNET transmission error 6608 MNET without ack 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
6602 MNET Line transmission hardware error 6603 MNET BUS busy 6606 MNET Line transmission error 6607 MNET transmission error 6607 MNET without ack 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
6603 MNET BUS busy 6606 MNET Line transmission error 6607 MNET transmission error 6608 MNET without ack 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
6606 MNET Line transmission error 6607 MNET transmission error 6607 MNET without ack 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		MIET PLIS hugy
6607 MNET transmission error 6607 MNET without ack 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
6607 MNET without ack 6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
6608 MNET transmission error 6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
6608 MNET without response 6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
6831 IR remote control transmission error (reception error) 6832 IR remote control transmission error (transmission error) 6840 Transmission error with the indoor/outdoor unit (reception error) 6841 Transmission error with the indoor/outdoor unit (transmission error) 6844 Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more) 6845 Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection) 6846 Initial timer deactivated		
6832IR remote control transmission error (transmission error)6840Transmission error with the indoor/outdoor unit (reception error)6841Transmission error with the indoor/outdoor unit (transmission error)6844Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more)6845Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection)6846Initial timer deactivated		
6840Transmission error with the indoor/outdoor unit (reception error)6841Transmission error with the indoor/outdoor unit (transmission error)6844Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more)6845Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection)6846Initial timer deactivated		
6841Transmission error with the indoor/outdoor unit (transmission error)6844Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more)6845Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection)6846Initial timer deactivated		
6844Error in inter-connection cable in the indoor/outdoor unit, indoor unit number deactivated (5 min or more)6845Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection)6846Initial timer deactivated		
6845Error in inter-connection cable in the indoor/outdoor unit (cabling error, disconnection)6846Initial timer deactivated		
6846 Initial timer deactivated		
	65535	Comunication error with the A.C.

Table 10.1 Error codes

In case you detect an error code not listed, contact your nearest Mitsubishi Electric technical support service.

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 28 of 31

11. EnOcean Interoperability

In this section there is a list of the allowed transmission and reception EEP

EEP Tx	EEP ¹ description
[05-02-01]	Light and Blind Control – Application Style 1
[07-02-05]	Temperature Sensor. Range 0°C to +40°C
[07-10-01]	Temperature Sensor; Set Point, Fan Speed and Occupancy Control
[07-10-03]	Temperature Sensor; Set Point Control
[07-20-10]	HVAC Components. Generic HVAC interface. Functions: Mode, vane
	position, fan speed, sensors and on/off
[07-20-11]	HVAC Components. Generic HVAC interface. Functions: Error
	control: AC Error code, Error states and disablements

Table 11.1	Allowed	transmission	(Tx) EEP
------------	---------	--------------	----------

EEP Rx	EEP description
[05-02-xx]	Rocker Switch, 2 Rocker
[05-03-xx]	Rocker Switch, 4 Rocker
[05-04-01]	Key Card Activated Switch
[06-00-01]	Single Input Contact
[07-02-05]	Temperature Sensor. Range 0°C to +40°C
[07-02-06]	Temperature Sensor. Range +10°C to +50°C
[07-07-01]	Occupancy Sensor
[07-08-01]	Light, Temperature & Occupancy Sensor
[07-08-02]	Light, Temperature & Occupancy Sensor
[07-10-01]	Temperature Sensor; Set Point, Fan Speed and Occupancy Control
[07-10-02]	Temperature Sensor; Set Point, Fan Speed and Day/Night Control
[07-10-03]	Temperature Sensor; Set Point Control
[07-10-04]	Temperature Sensor; Set Point and Fan Speed Control
[07-10-05]	Temperature Sensor; Set Point and Occupancy Control
[07-10-06]	Temperature Sensor; Set Point and Day/Night Control
[07-10-07]	Temperature Sensor; Fan Speed Control
[07-10-08]	Temperature Sensor; Fan Speed and Occupancy Control
[07-10-09]	Temperature Sensor; Fan Speed and Day/Night Control
[07-10-0A]	Temperature Sensor, Set Point Adjust and Single Input Contact
[07-10-0B]	Temperature Sensor and Single Input Contact
[07-10-0C]	Temperature Sensor and Occupancy Control
[07-10-0D]	Temperature Sensor and Day/Night Control
[07-10-10]	Temperature and Humidity Sensor; Set Point and Occupancy Control
[07-10-11]	Temperature and Humidity Sensor; Set Point and Day/Night Control
[07-10-12]	Temperature and Humidity Sensor; Set Point Control
[07-10-13]	Temperature and Humidity Sensor; Occupancy Control
[07-10-14]	Temperature and Humidity Sensor; Day/Night Control
[07-20-10]	HVAC Components. Generic HVAC interface. Functions: Mode, vane
	position, fan speed, sensors and on/off
[07-20-11]	HVAC Components. Generic HVAC interface. Functions: Error
	control: AC Error code, Error states and disablements
[07-30-02]	Digital Input. Single Input Contact

¹ EnOcean Equipment Profiles (EEP) V2.0

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 29 of 31

12. Regulations and standards

CE conformity:

R&TTE EU-directive on Radio and Telecommunications Terminal Equipment

The general registration for the radio operation is valid for all EU countries as well as for Switzerland.

Standards:

UNE-EN 50491-3:2010 UNE-EN 60950-1:2007 UNE-EN 61000-6-2:2006 UNE-EN 61000-6-3:2007

FCC ID: SZV-STM300C IC: 5731A-STM300C

The enclosed device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (i.) this device may not cause harmful interference and (ii.) this device must accept any interference received, including interference that may cause undesired operation.

Warning: Changes or modifications made to this equipment not expressly approved by Intesis Software may void the FCC authorization to operate this equipment.

Thermokon Sensortechnik GmbH - Aarstrasse 6 - 35756 Mittenaar - Tel.: 02772/65010 - Fax: 02772/6501400 - www.thermokon.de - email@thermokon.de produktblatt_stc_mitsubishi_ac_eng ©2011 Page 31 of 31